



Modine Manufacturing Company 1500 DeKoven Avenue, Racine Wisconsin
PH: 262-636-1200 Fax: 800-204-6011

Modine Commercial Technical Bulletin

Subject: Upgrade Condenser Fan Motor MCB's


Date:

To:

The Atherion Commercial Packaged Ventilation Unit, model MPR is designed to provide many years of trouble-free service in demanding conditions. However, the condenser fan circuit breakers in older units experience nuisance tripping in conditions of high cabinet temperature. It has been determined that those units had breakers that were undersized for their role. To correct this, Modine is supplying upgraded breakers that will enable the model MPR to perform as designed.

If nuisance condenser fan circuit breaker trips have occurred, please contact Modine Technical Service with the following information:

- Sales Order Number/Job Name
- Model Number
- Serial Number
- Breaker Rating
 - Note: Breaker rating will be stamped on the front of the breaker. These breakers are located in the compressor section pictured as item #2 below. Be sure to follow required precautions and equipment lockout procedures prior to opening cabinet doors.

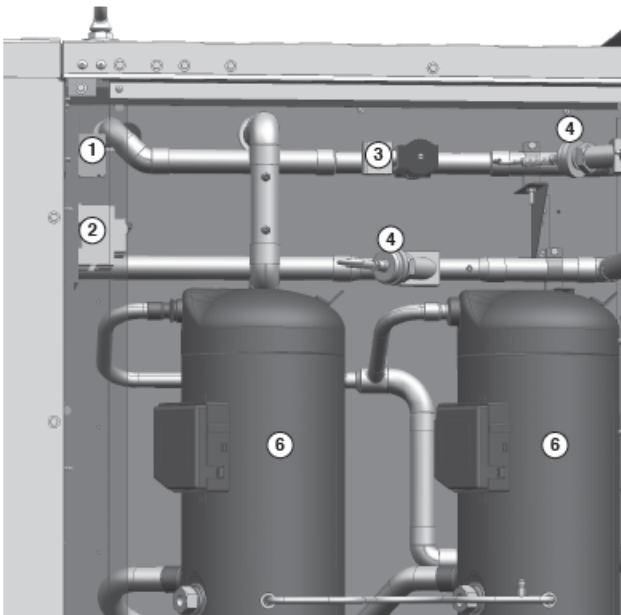

Depending on the existing breaker size, a suitable upgrade will be selected and provided as a no-charge warranty part.

Thank you for your business!